

IMSL

INDUSTRIAL MICROBIOLOGICAL SERVICES LTD

STUDY REPORT: **Determination of the Antibacterial Activity of Polyurethane Screed Formulations against *Escherichia coli*, *Staphylococcus aureus* and *Listeria monocytogenes* using ISO 22196 (Formally JIS Z 2801)**

Flowfresh HF (6 - 9 mm) 60 Washes

CLIENT: **Flowcrete UK Limited
Flowcrete Buisness Park
Booth Lane
Moston
Sandbach
Cheshire
CW11 3QF**

REPORT NO: **IMSL2015/02/014.1B**

DATED: **06th March 2015**

Study: Determination of the Antibacterial Activity of Polyurethane Screed Formulations against *Escherichia coli*, *Staphylococcus aureus* and *Listeria monocytogenes* using ISO 22196 (Formally JIS Z 2801)

Number: IMSL2015/02/014.1B

Client: Flowcrete UK Limited
Flowcrete Buisness Park
Booth Lane
Moston
Sandbach
Cheshire
CW11 3QF

The above study was conducted in the laboratories of Industrial Microbiological Services Ltd at Pale Lane Hartley Wintney, Hants, RG27 8DH, UK. This report represents a true and accurate account of the results obtained.

Report Issued 06th March 2015

Reason Consolidation and updating of normative references.

Supervisor Kyle Allison
Senior Microbiologist



Operator Richard Webb
Microbiologist



Contents

1	Introduction	1
2	Test Materials	1
3	Methods	1
3.1	Determination Antibacterial Activity	1
4	Results / Discussion	3
5	Raw Data	6
6	References	6
7	Exclusion of Liability	7

1 Introduction

This report summarises studies (Ref 1 and 2) performed to assess the antibacterial performance of a range of polyurethane screed formulations against *Escherichia coli*, *Staphylococcus aureus* and *Listeria monocytogenes* using the method described in the standard ISO 22196 (formerly JIS Z 2801).

2 Test Materials

Plaques which had been prepared using polyurethane resin floor screed formulated either with or without an antibacterial agent were supplied by Flowcrete UK Limited. Samples were processed at 50°C in a dishwasher without detergent for 60 cycles. All samples were held in the dark at 20°C prior to testing.

3 Methods


Antibacterial activity was determined using the method described in ISO 22196 / JIS Z 2801 (Ref 3 and 4).

3.1 Determination of Antibacterial Activity

An aliquot (225µl) of a log phase cell suspension of either *Escherichia coli* (8.0×10^5 cells ml⁻¹; ATCC 8739), *Staphylococcus aureus* (6.4×10^5 cells ml⁻¹; ATCC 6538p) or *Listeria monocytogenes* (5.2×10^5 cells ml⁻¹; NCTC 11994) prepared using the method described in ISO 22196 were held in intimate contact with each of 3 replicates of the test surfaces supplied using a 30 x 30 mm polyethylene film (cut from a sterile Stomacher bag) for 24 hours at 35°C. The size of the surviving population was determined using the method described in ISO 22196. The viable cells in the suspension were enumerated by spiral dilution on to Trypcase Soya Agar and by the pour plate method described in ISO 22196. These plates were incubated at 35°C for 24 hours and then counted. An additional 3 replicate unfortified surfaces were also inoculated in the manner described above but were then analysed immediately for the size of microbial population present to provide 0-time control data. The method is described schematically in Figure 1 below.

All data were converted to colony forming units (CFU) cm⁻² and then transformed (Log_{10}) to provide a data set that conformed to a Gaussian distribution.

Figure 1: ISO 22196 : - Schematic Representation

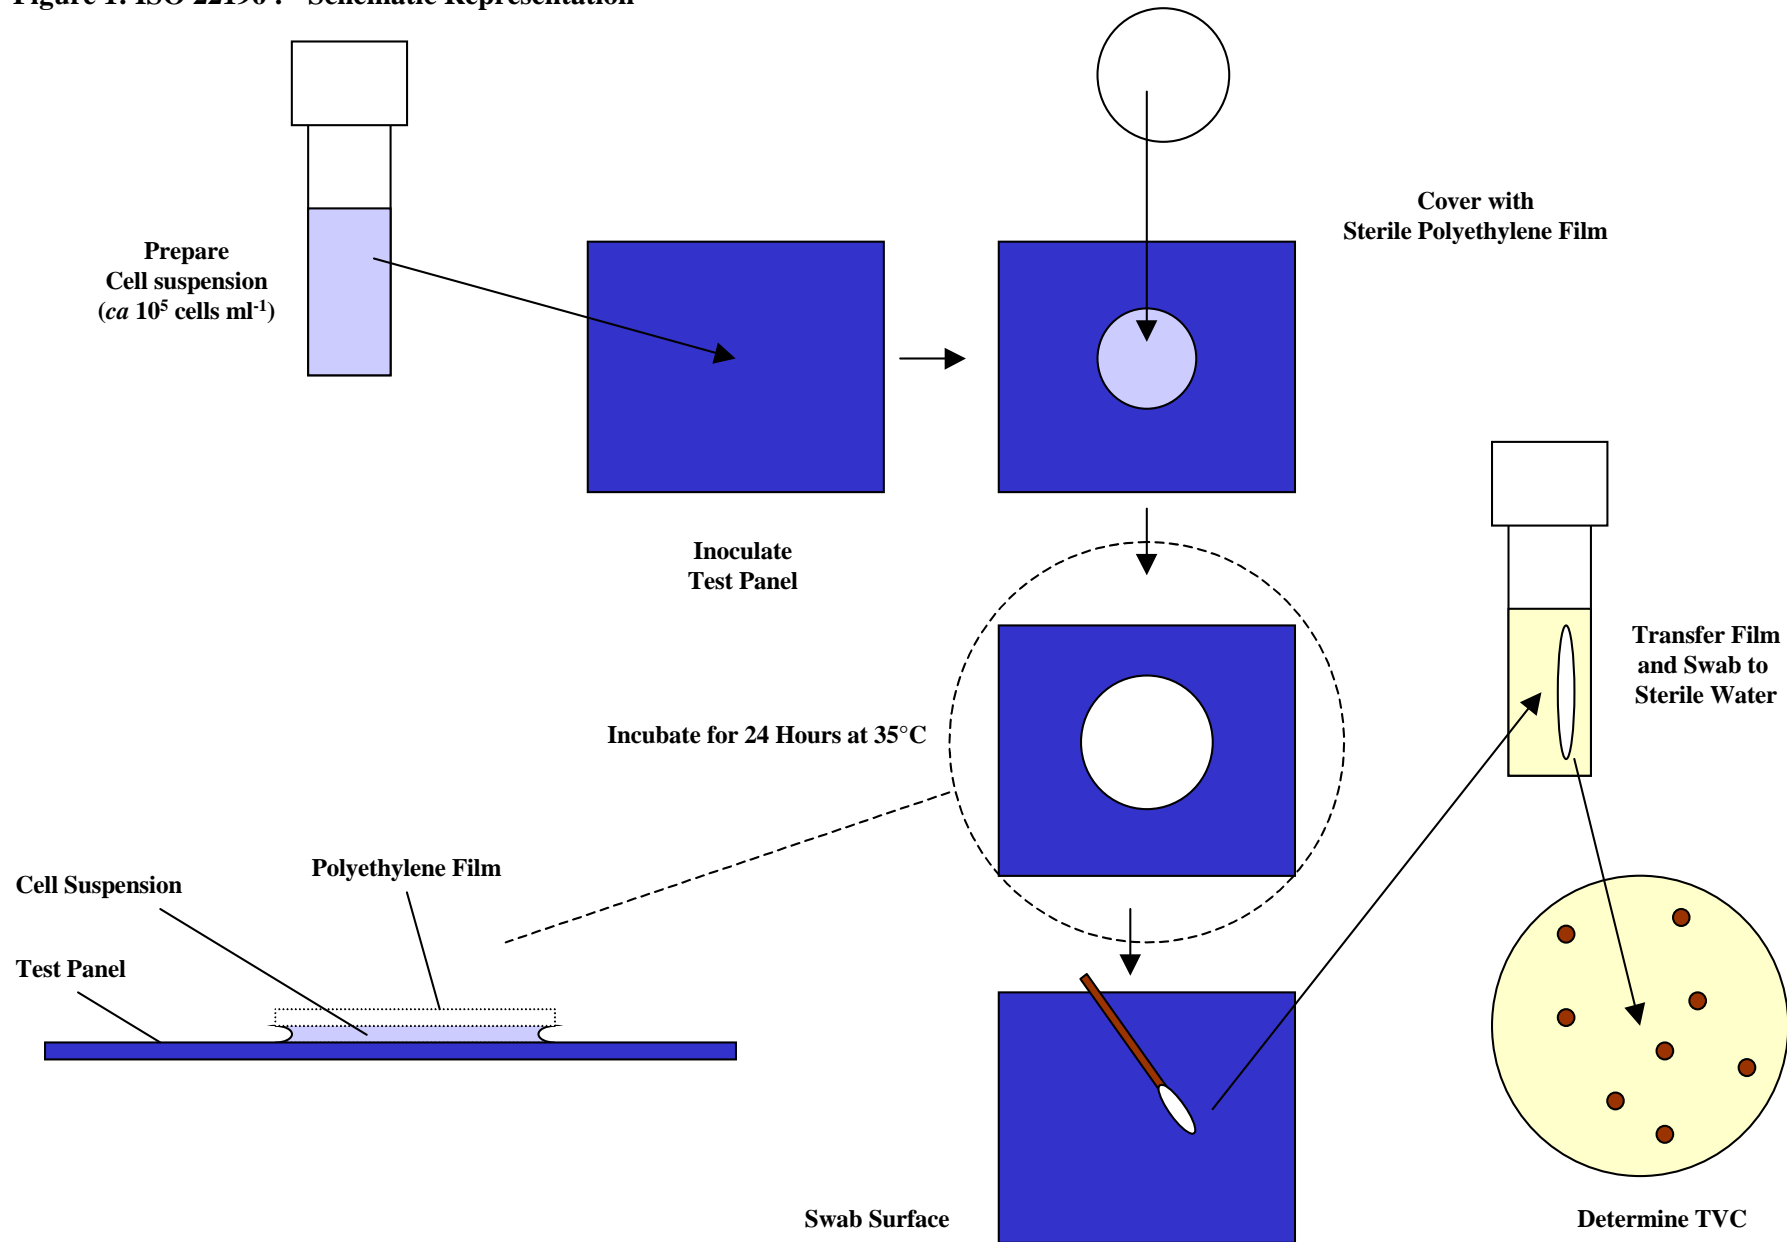

4 Results / Discussion

The results are shown in Tables 1 - 3 and Figure 2 below.

Table 1: Activity of Coatings Against *Escherichia coli* after 60 Wash Cycles (Geometric Mean of 3 Replicates as Colony Forming Units cm⁻²)

Sample	Contact Time		Reduction From Initial	
	0 hours	24 hours ‡	Log ₁₀	%
IMSL Reference Material	2.0 x 10 ⁴	1.9 x 10 ⁶	-	-
Polyurethane Resin Control	2.0 x 10 ⁴	3.0 x 10 ⁴	-	-
Flowfresh HF (6 - 9 mm)	2.0 x 10 ⁴	7.0 x 10 ⁰	3.5	99.97

‡ The theoretical limit of detection is 1 CFU cm⁻²

It can be seen from the results above that the population of *Escherichia coli* held in contact with the IMSL reference material increased in size by 2.0 orders of magnitude during the 24 hour contact interval. This is considered a normal response for this organism on an inert surface under the conditions imposed by ISO 22196. The population of *Escherichia coli* exposed to the surfaces of the Polyurethane Resin Control after 60 wash cycles remained relatively constant during the 24 hours contact interval. The population of *Escherichia coli* held in contact with the Sample of Flowfresh HF (6 - 9 mm) after 60 wash cycles declined by a 3.5 orders of magnitude after 24 hours compared to the initial population.

Table 2: Activity of Coatings Against *Staphylococcus aureus* after 60 Wash Cycles (Geometric Mean of 3 Replicates as Colony Forming Units cm⁻²)

Sample	Contact Time		Reduction From Initial	
	0 hours	24 hours ‡	Log ₁₀	%
IMSL Reference Material	1.6 x 10 ⁴	4.9 x 10 ⁴	-	-
Polyurethane Resin Control	1.6 x 10 ⁴	≤ 1.0	≥ 4.2	≥ 99.99
Flowfresh HF (6 - 9 mm)	1.6 x 10 ⁴	≤ 1.0	≥ 4.2	≥ 99.99

‡ The theoretical limit of detection is 1 CFU cm⁻²

The results in Table 2 show that the population of *Staphylococcus aureus* held in contact with the unfortified IMSL reference material remained relatively constant over the 24 hour contact interval. This is again considered a normal response for most Gram positive organisms under the conditions imposed by ISO 22196. The population of *Staphylococcus aureus* exposed to the Polyurethane Resin Control after 20 wash cycles declined by 3.6 orders of magnitude. The population of *Staphylococcus aureus* exposed to the surface of Flowfresh HF (6 - 9 mm) after 20 wash cycles declined by a further 0.6 orders of magnitude to below the limit of detection over the 24 hour contact period.

Table 3: Activity of Coatings Against *Listeria monocytogenes* after 60 Wash Cycles (Geometric Mean of 3 Replicates as Colony Forming Units cm⁻²)

Sample	Contact Time		Reduction From Initial	
	0 hours	24 hours ‡	Log ₁₀	%
IMSL Reference Material	1.3 x 10 ⁴	6.4 x 10 ³	0.3	48.89
Polyurethane Resin Control	1.3 x 10 ⁴	3.2 x 10 ²	1.6	97.44
Flowfresh HF (6 - 9 mm)	1.3 x 10 ⁴	4.7 x 10 ⁰	3.4	99.96

‡ The theoretical limit of detection is 1 CFU cm⁻²


The results in Table 3 above show that the population of *Listeria monocytogenes* held in contact with the unfortified IMSL Reference Material remained relatively constant over the 24 hour contact interval. This is considered a normal response for this species under the conditions imposed by ISO 22196. The population of *Listeria monocytogenes* exposed to the Polyurethane Resin Control after 20 wash cycles and Flowfresh HF (6 - 9 mm) after 20 wash cycles both declined by ≥ 4.2 orders of magnitude to below the limit of detection over the 24 hour contact interval.

It can be seen from the results above that significant antimicrobial activity against *Staphylococcus aureus* was detected against both the unfortified sample of Polyurethane Resin Control and Flowfresh HF (6 - 9 mm) even after 60 dishwasher cycles (good survival was achieved on a reference sample). However, survival of *Escherichia coli* and *Listeria monocytogenes* in contact with the unfortified control surface was achieved with the population of *Escherichia coli* remaining at a constant magnitude and the population of *Listeria monocytogenes* declining by 1.6 orders of magnitude during the 24 hour contact interval. In contrast, the populations of *Escherichia coli* and *Listeria monocytogenes* held in contact with the samples of Flowfresh HF (6 - 9 mm) were reduced by 3.0 and 3.4 orders of magnitude respectively compared to the initial population.

Like many antimicrobial agents, the inherent antimicrobial properties that seem to characterise the Polyurethane Control material tested appear to be stronger against *Staphylococcus aureus* and *Listeria monocytogenes* than *Escherichia coli*. Although durable, this inherent activity can clearly be reduced following repeated washing (as will happen in some end-use scenarios). Antibacterial activity resulting from the inclusion of an antimicrobial agent in Flowfresh HF (6 - 9 mm) is retained even after 60 washes and activity against all 3 test species is expressed after 24 hours contact. The longevity of this effect as well as the impact of certain soiling agents is unknown at present but is likely to be concentration dependent. As the effect is achieved through the emission of silver ions, activity in the absence of free water will be limited to accelerating the rate of decline of populations present in splashes of liquids. However, in applications where either the whole area of the floor or certain areas (maybe just pockets and crevices) remains wet / moist for extended periods (eg in certain food manufacturing environments), it is likely that the effect will be expressed. As mentioned above, soiling as well as ambient temperature will have an impact on this effect; the addition rate as well as the contact time will also have some impact on this.


Figure 2: Results as Log₁₀ CFU cm⁻² after 60 Dishwasher Cycles

Escherichia coli

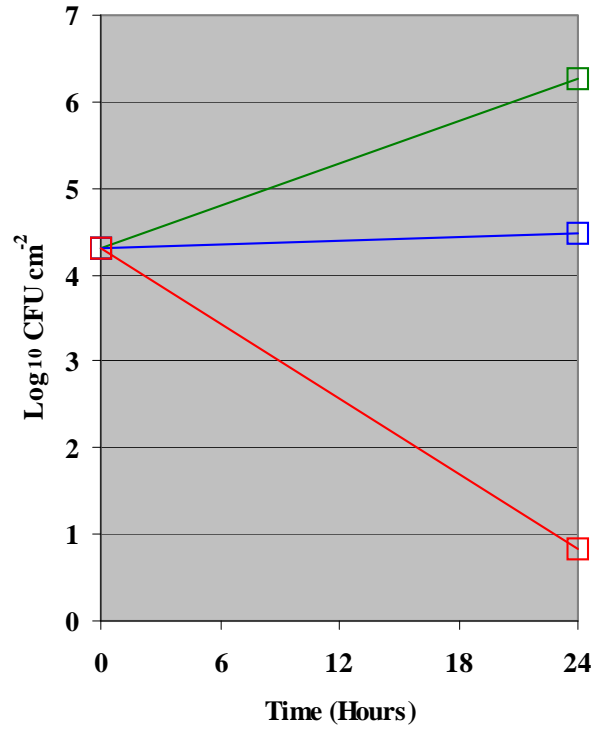


- IMSL Reference Material
- Polyurethane Resin Control
- Flowfresh HF (6 - 9 mm)

Staphylococcus aureus

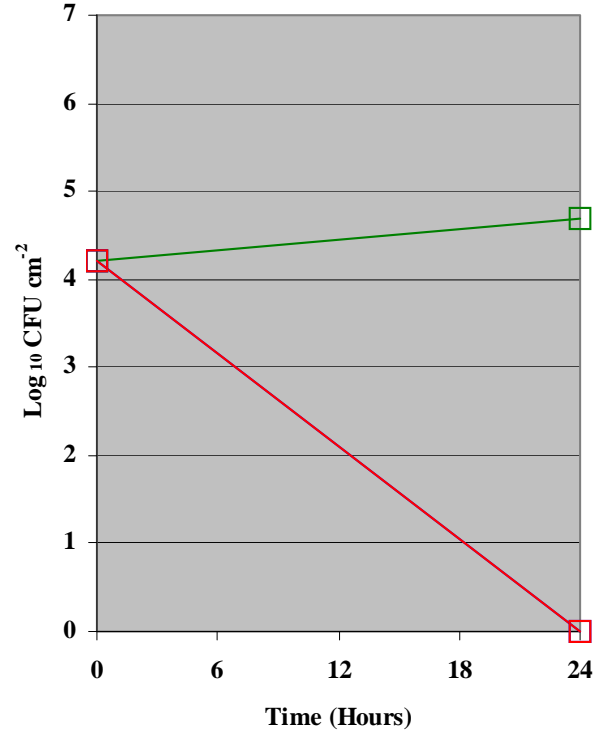

- IMSL Reference Material
- Polyurethane Resin Control
- Flowfresh HF (6 - 9 mm)

Listeria monocytogenes

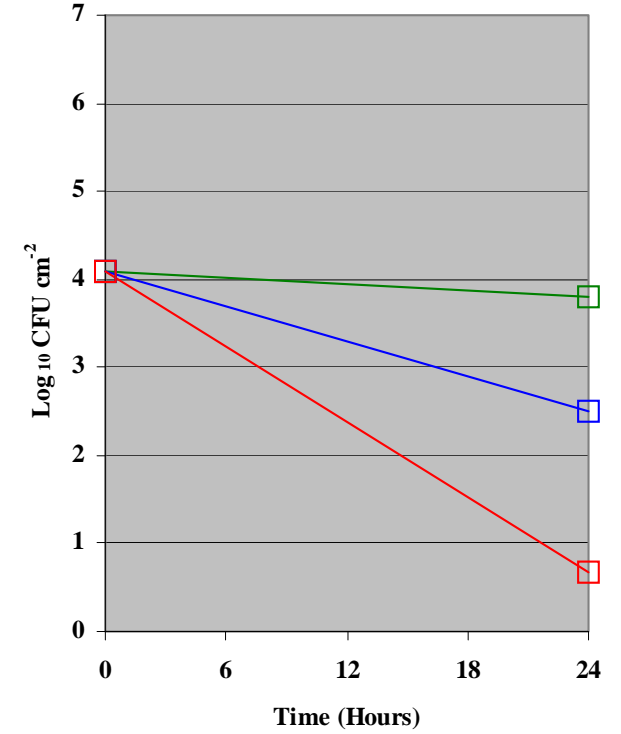

- IMSL Reference Material
- Polyurethane Resin Control
- Flowfresh HF (6 - 9 mm)

5 Raw Data

The raw data for this study will be held in file IMSL 2015/02/014 in the Archive of IMSL at Pale Lane, Hartley Wintney, Hants, RG27 8DH, UK for 6 years from the date of this report unless other specific instructions are given.

6 References

- 1 Technical Letter: IMSL 2006/11/013.2 - Antibacterial Activity of Cast Flooring Systems
- 2 Report: IMSL 2008/11/013.1D - Determination of the Antibacterial Activity of Polyurethane Screed Formulations against *Listeria monocytogenes* using Japanese Industrial Standard JIS Z 2801: 2000.
- 3 Anon, ISO 22196 : 2007, Measurement of antibacterial activity on plastic surfaces.
- 4 Japanese Industrial Standard JIS Z 2801: 2000 (E)

7 Exclusion of Liability

The contents of this report are subject to the standard terms and conditions of IMSL as displayed on the reverse of the invoice. Specific attention is drawn to Section 10 restated below.

- (a) IMSL warrants that the results as stated in this Report are accurate in so far as they relate to the Samples as received in the laboratory of IMSL. Except in respect of death or personal injury caused by IMSL's negligence IMSL accepts no other liability or responsibility to any party whatsoever (whether caused by the negligence of IMSL, its employees, or agents or otherwise) arising out of or in connection with the provision of this Report. In particular, but without prejudice in the generality of the foregoing IMSL shall have no liability or responsibility whatsoever in respect of or in any way by reference to:-
- (i) the taking of the Samples (unless this is done by an agent of IMSL), the accuracy of the Samples or their suitability for the purpose(s) for which they were taken or applied, the designation, handling, storage or transport of the Samples prior to their delivery to the laboratory of IMSL or their condition upon such delivery
 - (ii) the interpretation of the Report and / or the application of the results as stated and / or the accuracy of any advices based thereon
 - (iii) any (or any alleged) lack of competence, negligence, failure or breach of duty on the part of any person engaged in or responsible for any of the activities or functions referred to above whether or not such agent is described as an agent of IMSL or otherwise. All such persons shall be deemed to be agents of the Customer and not to be agents or representatives in any capacity of IMSL
 - (iv) incorrect information or data supplied by the Customer relating to the Samples
 - (v) loss of or damage to the Samples when in the possession of IMSL
 - (vi) delay in provision of the Service or mis-delivery or non-delivery of any Report or Sample.
- (b) In the event of any claim arising against IMSL, IMSL expressly excludes liability for any consequential loss or damage or any loss of value, profit, business, revenue, goodwill, yields, production or anticipated saving which may arise in respect of or in any way by reference to any Report, analysis, advice or information given verbally by any person or contained in any Report, leaflet, book, pamphlet, brochure or any other document, whether prepared, published or issued by IMSL or otherwise.